


## Physical instructions for installation

Electric heater 7,5-10 kW with UKU Glass Black control unit

Affixing the sensor to the ceiling:  
distance from heater frame 100–300 mm

The temperature sensor should be installed no less than 1000 mm from an undirected air vent income, or less than 500 mm from a directed air vent.

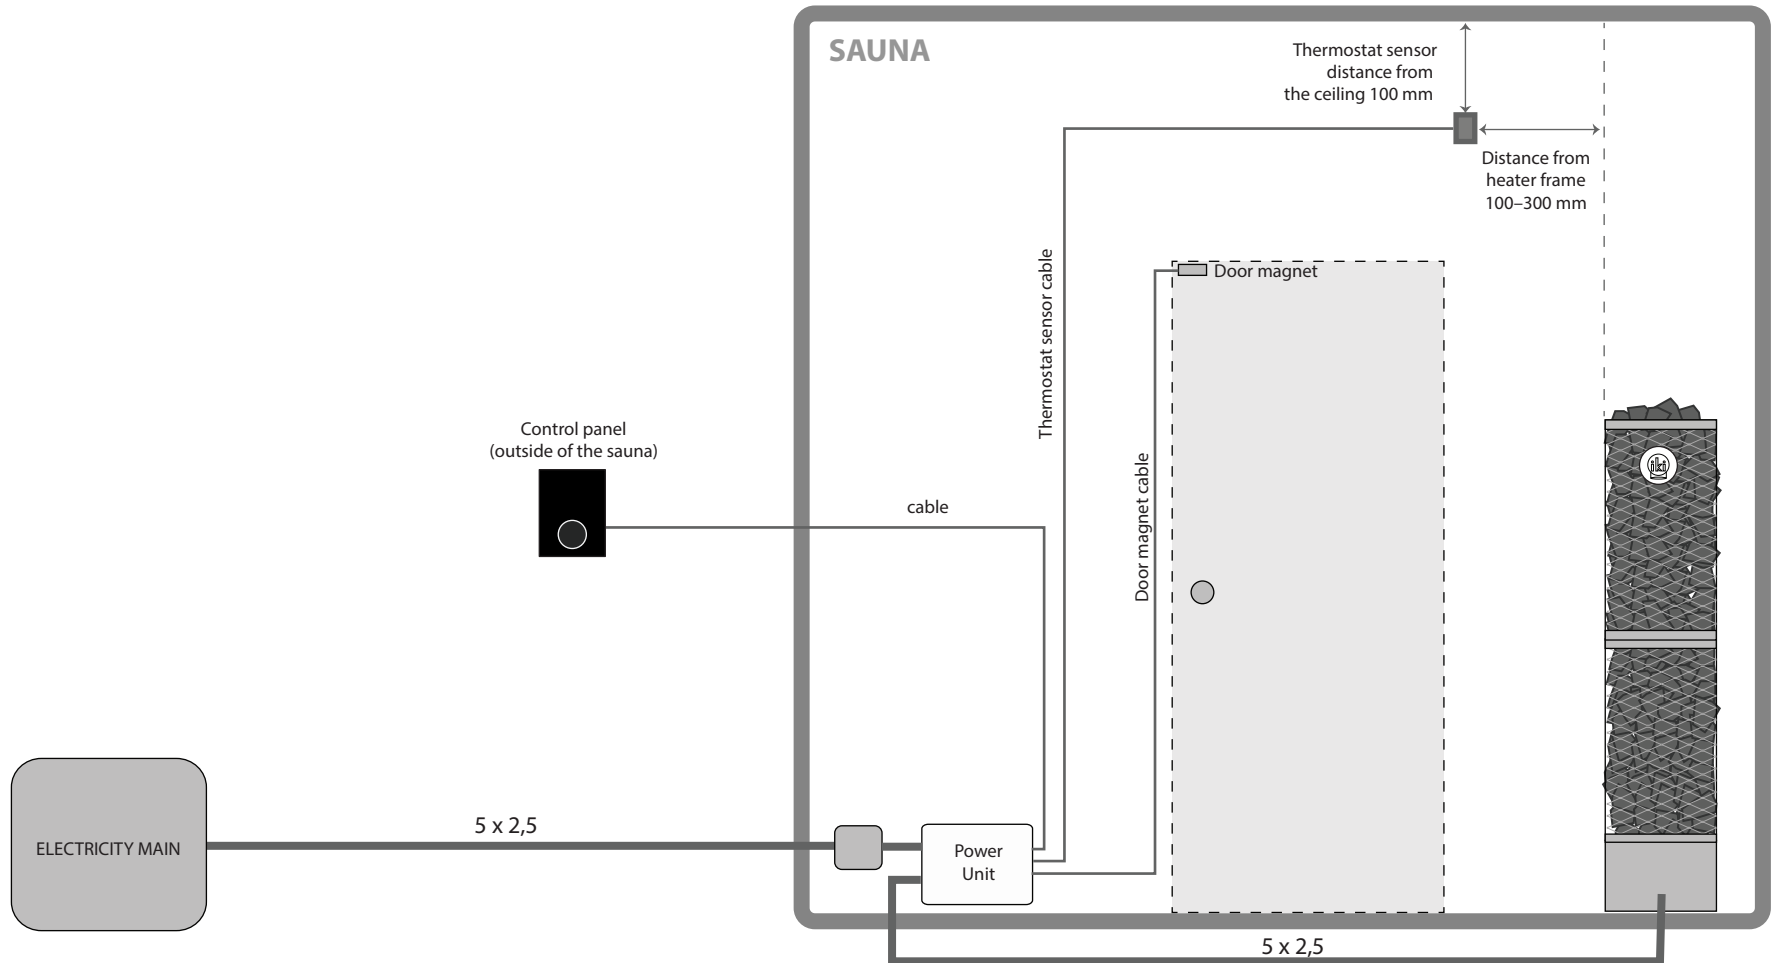

Power unit can be installed inside the sauna up till 12 kW. Install the power unit close to floor and as far as possible from the heater.