


## Physical instructions for installation

Monolith electric heater 9 kW with UKU Glass Black control unit

Affixing the sensor to the ceiling:  
distance from heater frame 100–300 mm

The temperature sensor should be installed no  
less than 1000 mm from an undirected air vent income,  
or less than 500 mm from a directed air vent.

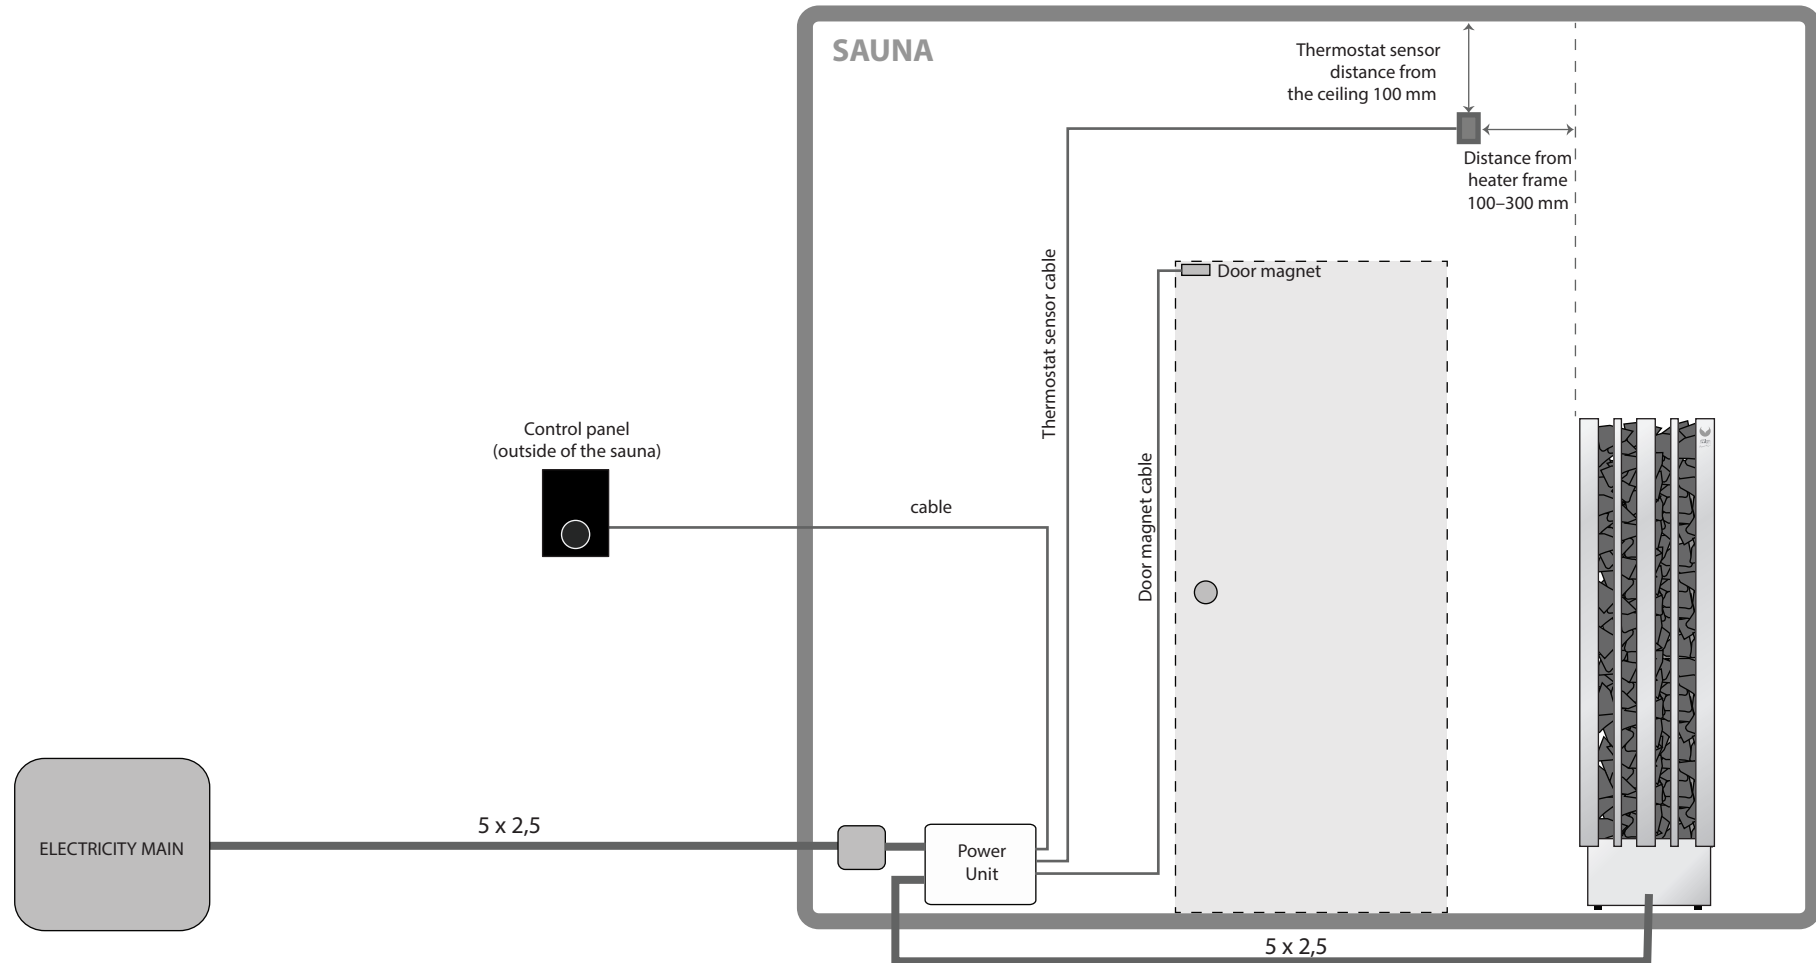

If Power unit is installed  
inside the sauna:  
install the power unit close to  
floor (max. 30 cm) and as far as possible  
from the heater (min. 100 cm).