


Physical instructions for installation

Monolith electric heater 13,8-18 kW with UKU Glass Black control unit

Affixing the sensor to the ceiling:
distance from heater frame 100–300 mm

The temperature sensor should be installed no
less than 1000 mm from an undirected air vent income,
or less than 500 mm from a directed air vent.

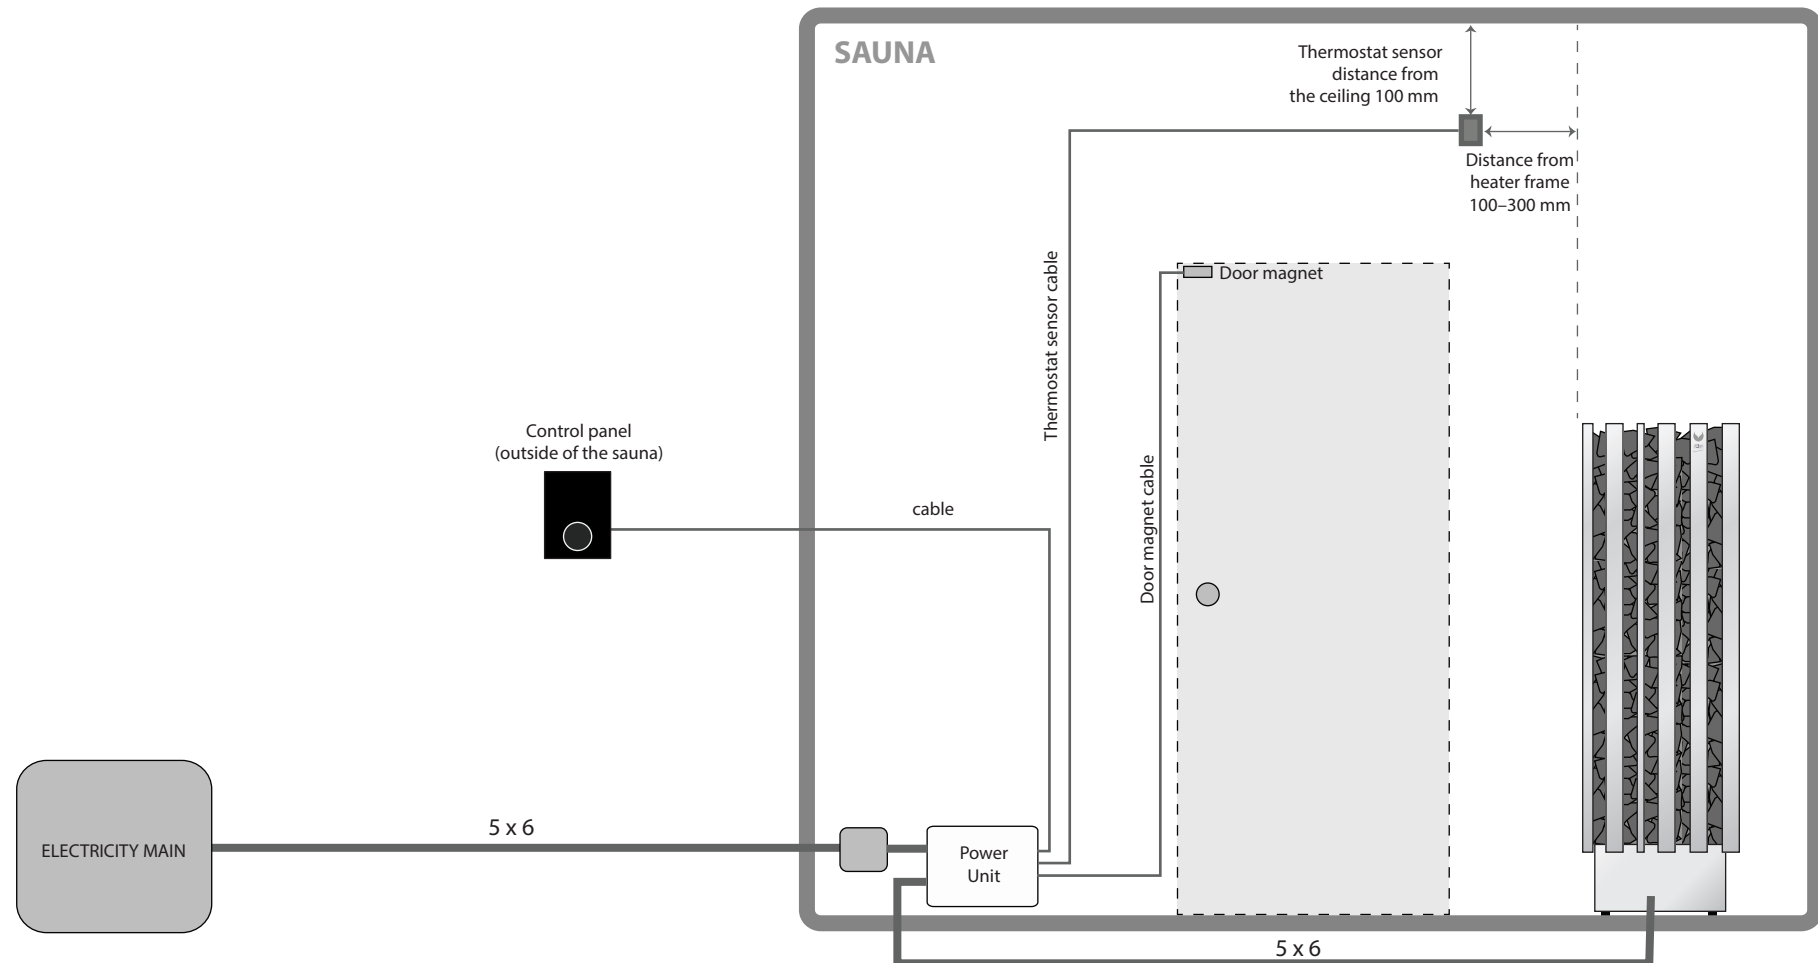

If Power unit is installed
inside the sauna:
install the power unit close to
floor (max. 30 cm) and as far as possible
from the heater (min. 100 cm).